

LIGHTWEIGHT STEEL FRAMING MEMBER SECTION TABLES

58-2018 June 2018

Prepared for: Canadian Sheet Steel Building Institute

Prepared by: Prof. R.M. Schuster, P.Eng. Distinguished Professor Emeritus, University of Waterloo

Copyright© June 2018 All rights reserved. This publication, nor any part thereof, may be reproduced in any form without the written permission of the publisher.

Preface:

The material here in presented has been prepared for the general information of the reader. While the material is believed to be technically correct and in accordance with recognized good practice at the time of publication it should not be used without first securing competent advice with respect to its suitability for any specific application. Neither Bailey Metal Products Limited, the **Canadian Sheet Steel Building Institute**, nor Prof. Schuster warrant or assume any liability for the suitability of the material for any general or particular application.

Founded in 1950, Bailey Metal Products Limited is a family owned and operated Canadian company. The Bailey Group of Companies is recognized as the industry leader, offering building solutions to both the commercial and residential construction markets. Our products include Structural Lightweight Steel Framing (LSF), Non-Loadbearing Steel Framing, Steel Framing Accessories, Connectors & Clips, COMSLAB Steel Composite Concrete Floor, Drywall Trims and Accessories.

Our team stands ready to provide products and technical support that meet your building team's needs. We would love to collaborate with you to satisfy your sound, structural or other performance requirements.



Canadian Sheet Steel Building Institute
A division of the Canadian Institute of Steel Construction

CSSBI is Canada's foremost authority on sheet steel, its products, and its many applications. They are an industry association responsible for the development and dissemination of industry standards. A source for technical information and resources, they provide expert guidance to the general public and sheet steel manufacturers alike.

Canadian Sheet Steel Building Institute • www.cssbi.ca • info@cssbi.ca • (519) 650-1285

TABLE OF CONTENTS

General Notes

Introduction	4
Product Designator	4
Manufacturer Certification and Product Marking	4
Section Geometries	5
Section Properties	6
Symbols	7
Design Examples	8

Section Properties

Stud Section Properties	12
Joist Section Properties	14
Track Section Properties	16
Curtain Wall Limiting Height Tables – Single and Double Spans	19
Combined Axial and Lateral Load Tables	36
Floor Joist Load Tables	69
Header Load Tables	78
Web Crippling Data	83
S-Section Ceiling Span Tables	86
U-Channel Section Properties	87
U-Channel Ceiling Span Tables	88
Furring Channel Section Properties	89
Furring Channel Ceiling Span Tables	90

GENERAL NOTES


1. INTRODUCTION

The technical data in this publication is intended as an aid to the design professional and should not be used to replace the judgement of a qualified Engineer or Architect.

2. PRODUCT DESIGNATOR

Lightweight steel framing manufacturers in Canada use a common designator method for identifying their products. The designator is a four-part code that identifies depth, flange width, member type and material thickness. This designator (based on Imperial units) is used for both SI metric and Imperial units.

Example: 600S162-54

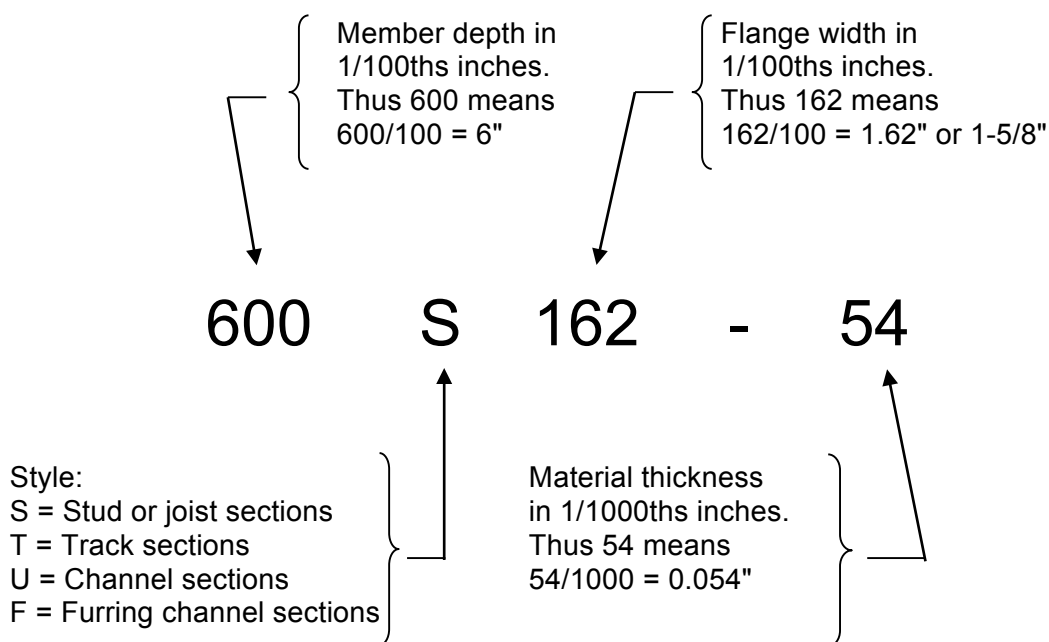

3. MANUFACTURER CERTIFICATION AND PRODUCT MARKING

- 3.1 Lightweight steel framing manufacturers who are members of the CSSBI and adhere to the **CSSBI Manufacturer Certification Requirements for Cold Formed Steel Framing Members** are the only companies that have authorization from the CSSBI to utilize these tables.

Under the *CSSBI Manufacturer Certification Program*, a participating manufacturer certifies that the designated structural and non-structural cold formed steel (CFS) framing members

it produces meet or exceed the relevant ASTM International (ASTM), Canadian Standards Association (CSA) and American Iron and Steel Institute (AISI) standard requirements. The manufacturer's products are validated through an independent 3rd party re-view of the products and production practices, by appropriate testing and inspection.

3.2 Marking:

Individual products shall have a legible label, stencil, or embossment on the member with the following minimum information:

- (a) Initials "CSSBI";
- (b) Manufacturer's identification (2 or 3 letters);
- (c) Designation steel thickness (in mils) exclusive of protective coatings; and,
- (d) A reference number identifying the source coil.

Example: "CSSBI-XYZ-33 ABCD" would be a 33 mil thick product manufactured by XYZ company who is a CSSBI Manufacturer Member from a coil that can be traced through the reference number "ABCD".

Additional information may also be included at the discretion of the manufacturer.

4. SECTION GEOMETRIES

4.1 Section geometries are identified by the product designator method described in Section 2.

4.2 Stud, joist, track and bridging channel members shall be cold formed to shape from sheet steel with a minimum base steel thickness and inside bend radius as follows:


Designation Thickness (mil)	Minimum Base Steel Thickness (mm)	Base Steel Design Thickness (mm)	Inside Bend Radius (mm)
18	0.455	0.478	2.141
33	0.836	0.879	1.941
43	1.087	1.146	1.808
54	1.367	1.438	2.156
68	1.720	1.811	2.715
97	2.454	2.583	3.874

4.3 Stud and joist lip lengths are as follows:

Section	Flange Width (mm)	Lip Length (mm)
S125	31.8	4.76
S162	41.3	12.7
S200	50.8	15.9
S250	63.5	15.9
S300	76.2	15.9

5. SECTION PROPERTIES

- 5.1 Structural properties are based on Limit States Design (LSD) of the CSA Standard S136-16, *North American Specification for the Design of Cold-Formed Steel Structural Members*, 2016 edition (S136-16).
- 5.2 Steel shall conform to the requirements of S136-16, AISI S220-15 *North American Standard for Cold-Formed Steel Framing - Nonstructural Members* and AISI S240-15 *North American Standard for Cold-Formed Steel Structural Framing*. Products with a design thicknesses less than or equal to 1.146 mm shall have a minimum yield strength of 230 MPa and products with a design thicknesses equal to or greater than 1.438 mm shall have a minimum yield strength of 345 MPa.
- 5.3 Section properties are computed for the base steel design thicknesses (exclusive of coating) shown in the tables.
- 5.4 When provided, factory punchouts shall be located along the centreline of the webs of the members and shall have a minimum centre-to-centre spacing of 610 mm. Punchouts for members greater than 64 mm deep are a maximum of 38 mm wide by 114 mm in length. Any configuration or combination of holes that fit within the punchout width and length limitations stated above shall be permitted; other punchout configurations and locations not in compliance with the stated limitations must be approved by a design professional.

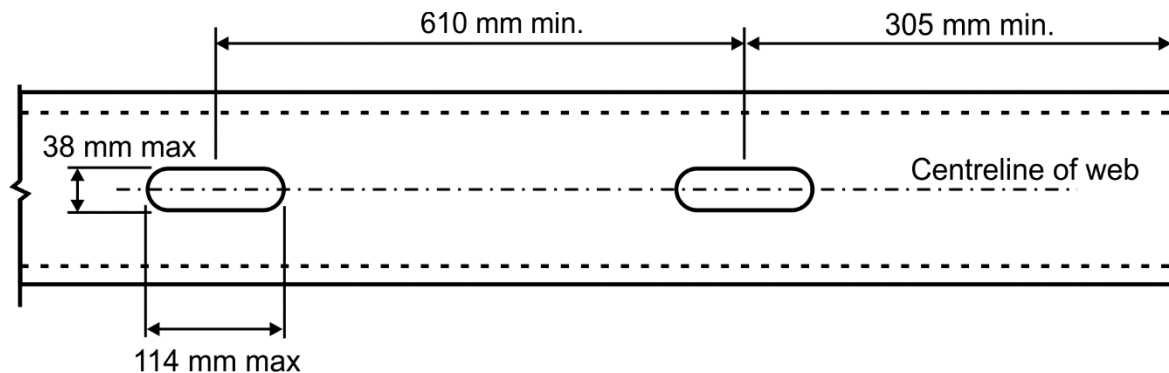

- 5.5 Increase in yield strength from cold work of forming has been included whenever applicable.
- 5.6 The effective moment of inertia for deflection, I_{xd} , is based on local buckling at an assumed specified live load stress of $0.6F_y$. This moment of inertia is only appropriate for checking serviceability limit states.

6. SYMBOLS

Gross Properties


I_x	Moment of inertia about x-axis
I_y	Moment of inertia about y-axis
r_x	Radius of gyration about x-axis
r_y	Radius of gyration about y-axis
V_{rg}	Factored shear resistance along y-axis of unperforated section

Effective Properties

I_{xd}	Moment of inertia about x-axis for deflection calculations
M_{rx}	Factored moment resistance for track, U-channel and furring channel sections based on local buckling
M_{rxDB}	Factored moment resistance about x-axis based on distortional buckling, assuming $K_\phi = 0$
M_{rxLB}	Factored moment resistance about x-axis based on local buckling
M_{ryDB}	Factored moment resistance about y-axis based on distortional buckling with lip in compression
M_{ryLB}	Factored moment resistance about y-axis based on local buckling with web/lip in compression
S_{xe}	Effective section modulus about x-axis
V_m	Factored shear resistance along y-axis of perforated section

Torsional and other Properties

β	$1 - (x_o/r_o)^2$
C_w	Torsional warping constant
J	Saint-Venant torsion constant.
L_u	Limiting unbraced length below which lateral-torsional buckling is not considered
m	Distance from shear centre to mid-plane of web
r_o	Polar radius of gyration about shear centre
x_o	Distance from shear centre to centroid along principle x-axis

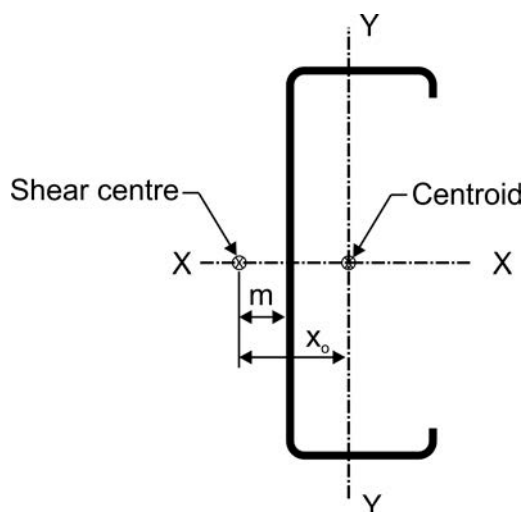

Web Depth to Thickness Ratio (h/t)

Designation Thickness (mil)	18		33		43		54		68		97	
Base Design Thickness (mm)	0.478		0.879		1.146		1.438		1.811		2.583	
Section Depth (mm)	h(mm)	h/t	h(mm)	h/t	h(mm)	h/t	h(mm)	h/t	h(mm)	h/t	h(mm)	h/t
41.3	36.1	75.5										
63.5	58.2	122										
92.1	86.9	182	86.4	98.3	86.1	75.2	84.8	59.0	83.1	45.8	79.2	30.6
102	96.3	202 ¹	96.0	109	95.8	83.5	94.5	65.7	92.5	51.1	88.6	34.3
152	147	*	147	167	147	128	145	101	143	79.2	139	54.0
203			198	225 ¹	197	172	196	136	194	107	190	73.7
254			248	*	248	217 ¹	247	172	245	135	241	93.3
305			299	*	299	*	298	207 ¹	296	163	292	113
356			350	*	350	*	348	242 ¹	346	191	343	133

¹ h/t exceeds 200; * h/t exceeds 260

7. DESIGN EXAMPLES

7.1 LOAD BEARING WALL STUDS – Concentric load only

Given:

Specified (unfactored) Loads: Axial live load (L) = 20.5 kN/stud
Axial dead load (D) = 9.0 kN/stud

Stud height = 4.4 m

Stud spacing = 406 mm o.c.

Assume studs are braced by bridging only

Select a stud section

Solution:

Factored load combination = 1.25D + 1.5L

$C_f = 1.25(9.0) + 1.5(20.5) = 42.0 \text{ kN/stud}$

Try 600S162-68 studs at 406 mm o.c.

From Combined Axial and Lateral Load table, the limiting factored compressive resistance for 0 kPa factored lateral load

$C_r = 45.5 \text{ kN/stud}$

Since $C_r = 45.5 \text{ kN/stud} > C_f = 42.0 \text{ kN/stud}$

∴ OK

Conclusion:

Use **600S162-68** section spaced at 406 mm o.c. with 3 bridging lines arranged so that the maximum spacing does not exceed 1.22 m o.c.

7.2 LOAD BEARING WALL STUDS – Combined loading**Given:**

Specified (unfactored) Loads: Axial live load (L) = 15.0 kN/stud
 Axial dead load (D) = 8.0 kN/stud
 Wind load (W) = 1.25 kPa

Stud height = 3.2 m

Stud spacing = 406 mm o.c.

Deflection limit = L/600

Assume studs are braced by bridging only

Select a stud section

Solution:

Try 600S162-54 studs at 406 mm o.c.

1) Dead load only

Factored load combination = 1.4D

C_f (factored axial load) = 1.4D = 1.4(8.0) = 11.2 kN/stud

From Combined Axial and Lateral Load table, the limiting factored compressive resistance for 0 kPa factored lateral load

C_r = 36.6 kN/stud

Since C_r = 36.6 kN/stud > C_f = 11.2 kN/stud **∴ OK**

2) Dead + Wind + Live Load

a) Factored load combination # 1 = 1.25D + 1.5L + 0.4W

W_f (factored wind load) = 0.4W

 = 0.4(1.25) = 0.5 kPa

C_f (factored axial load) = 1.25D + 1.5L

 = 1.25(8.0) + 1.5(15.0)

 = 32.5 kN/stud

From Combined Axial and Lateral Load table, the limiting factored compressive resistance for 0.50 kPa factored lateral load

C_r = 33.7 kN/stud

Since C_r = 33.7 kN/stud > C_f = 32.5 kN/stud **∴ OK**

b) Factored load combination # 2 = 1.25D + 0.5L + 1.4W

W_f (factored wind load) = 1.4W

 = 1.4(1.25) = 1.75 kPa

C_f (factored axial load) = 1.25D + 0.5L

 = 1.25(8.0) + 0.5(15.0)

 = 17.5 kN/stud

From Combined Axial and Lateral Load table, the limiting factored compressive resistance for 1.5 kPa and 2.0 kPa factored lateral load

C_r = 28.0 kN/stud (for 1.5 kPa)

C_r = 25.3 kN/stud (for 2.0 kPa)

By interpolation for 1.75 kPa, C_r = 26.7 kN/stud > 17.5 kN/stud **∴ OK**

3) **Web crippling check**

From Single Span Curtain Wall Limiting Heights table for a 1.25 kPa specified wind load, web crippling does not control.

4) **Deflection check (L/600)**

From Single Span Curtain Wall Limiting Heights table, the limiting stud height for a specified wind load of 1.25 kPa and a deflection limit of L/600 is 4.3 m.

Since 4.3 m > 3.2 m

∴ **OK**

Conclusion:

Use **600S162-54** section spaced at 406 mm o.c. with 2 bridging lines arranged so that the maximum spacing does not exceed 1.22 m o.c.

7.3 FLOOR JOIST – Single span

Given:

Specified (unfactored) Loads:	Live load (L)	= 2.0 kPa
	Dead load (D)	= 0.70 kPa

Single span length = 4.8 m

Joist spacing = 406 mm o.c.

Deflection limit = L/360

Select a joist section

Solution:

Strength

Factored load combination = 1.25D + 1.5L

$P_f = 1.25(0.70) + 1.5(2.0) = 3.88 \text{ kPa}$

Try 800S162-54 joists at 406 mm o.c.

From Floor Joist Load table, the factored uniformly distributed single span Strength Resistance = 4.5 kPa

Since 4.5 kPa > 3.88 kPa

∴ **OK**

Deflection

From Floor Joist Load table, the specified uniformly distributed single span L/360 deflection load is 2.2 kPa

Since 2.2 kPa > 2.0 kPa

∴ **OK**

Conclusion:

Use **800S162-54** section spaced at 406 mm o.c.

Web stiffeners are not required based on an end bearing length of 89 mm. If end bearing length is less than 89 mm, web crippling must be checked.

7.4 CURTAIN WALL – Single span

Given:

Specified (unfactored) wind load = 1.5 kPa

Stud height = 3.5 m

Stud spacing = 610 mm o.c.

Deflection limit = L/360

Select a stud section

Solution:

Try 600S162-43 studs at 610 mm o.c.

From Single Span Curtain Wall Limiting Heights table under 1.5 kPa specified wind load, the limiting stud height is 3.7 m

Since $3.7\text{ m} > 3.5\text{ m}$

∴ OK

Conclusion:

Use **600S162-43** section spaced at 610 mm o.c. Web stiffeners are not required.

7.5 CURTAIN WALL – Double span**Given:**

Specified (unfactored) wind load = 2.5 kPa

Stud height = 3 m

Stud spacing = 610 mm o.c.

Deflection limit = L/360

Select a stud section

Solution:

Try 800S162-43 studs at 610 mm o.c.

From Double Span Curtain Wall Limiting Heights table under 2.5 kPa specified wind load, the limiting stud height is 3.1a m

Since $3.1\text{ m} > 3\text{ m}$

∴ OK

Conclusion:

Use **800S162-43** section spaced at 610 mm o.c. Web stiffeners are required at end and interior supports.

7.6 USE OF WEB CRIPPLING DATA TABLE – Single Web Member**Given:**

Single web C-section

Depth = 203 mm

Designation thickness = 54 mil; Base Design Thickness, $t = 1.438\text{ mm}$

Bearing length, $N = 75\text{ mm}$

Determine the factored end-one-flange (EOF) web crippling resistance.

Solution:

From the Factored Web Crippling Data table for Single Web Members

$P_{eo1} = 1.36\text{ kN}$; $P_{eo2} = 0.48\text{ kN}$

$$P_{rEOF} = P_{eo1} + P_{eo2} \sqrt{\frac{N}{t}} = 1.36 + 0.48 \sqrt{\frac{75}{1.438}} = \underline{4.83\text{ kN}}$$

Conclusion:

The factored end-one-flange (EOF) web crippling resistance, $P_{rEOF} = \underline{4.83\text{ kN}}$